

# Executive Summary by Allen Johnston - Chief Technology Officer, EcoQuest International University of Cincinnati Test Results

## EcoQuest ActivePure technology effect on air contaminants

### Summary:

Testing of EcoQuest's Fresh Air Technology has been performed over an 18 month period at the Center for Health-Related Aerosol Studies in the Department of Environmental Health at the University of Cincinnati under the direction of Dr. Sergey Grinshpun, Professor.

Testing included two technologies used in the Fresh Air system; Negative Ionization and Photocatalysis (an innovative proprietary Photocatalytic Reactor called Radiant Catalytic Ionization - ActivePure).

### Each technology was evaluated independently:

- Fresh Air Ionization technology was able to reduce airborne particles from indoor air by up to 250 times over natural decay (gravity)
- Fresh Air Radiant Catalytic Ionization (ActivePure -RCI) was able to inactivate approximately 90% of airborne microorganisms in less than 60 minutes. The microorganisms tested were MS2 Virus and B. Subtilis (used as a surrogate for Anthrax).

Dr. Grinshpun also concluded that the combination of the two technologies provided a much more significant reduction of airborne biocontaminants than either of the two technologies working independently.

### About the Author:

Dr. Grinshpun is one of the most respected scientists in this important field of Aerosol Studies. Through his career, Dr. Grinshpun authored or co-authored about 390 scientific publications, including 120+ original articles in peer-reviewed journals, 90 book chapters and full proceeding papers, as well as about 180 conference abstracts. He has served as a reviewer, panel member or consultant to several federal agencies and professional associations nationally and internationally as well as for major companies and research institutions. He has also served on the Editorial Boards of four journals with international circulation. Dr. Grinshpun's accomplishments in aerosol research were recognized through the International Smoluchowski Award from the European Aerosol Assembly (1996, The Netherlands), the AIHA Outstanding Aerosol Paper Award (1997, USA), and the David L. Swift Memorial Award (2001, USA). He also received two John M. White Awards from AIHA (1997, 1998, USA) for his contribution to respiratory protection studies and Best Practice Award from the US

Department of HUD (2000) for his studies of leaded particles in indoor air.

### About the University:

University of Cincinnati is one of America's foremost Universities for Environmental Health.

### About the Testing:

The testing by Dr. Grinshpun and his team focused on controlling aerosol contaminants in the indoor air through the application of two technology strategies:

- 1) Particle Concentration Reduction due to Unipolar Ion Emission
- 2) Microbial Inactivation due to the Photocatalytic reaction promoted by a Photocatalytic process called ActivePure - RCI (Radiant Catalytic Ionization)

### The Results:

The paper concludes that the utilization of two mechanisms; ionization and oxidation, provide for significantly less exposure to potentially harmful contaminants in the air than either mechanism independently.

This conclusion is supported by showing ion induced air cleaning removes about 80% of viable airborne pathogens from a room air in 30 min, and the ActivePure-induced photooxidation inactivates about 90% of the remaining airborne microorganisms. The combination of both mechanisms resulted in an overall aerosol exposure reduction after 30 min by a factor of about 50, or an overall reduction/inactivation of approximately 98%.

### The two active contaminants evaluated were:

- 1) B. subtilis bacteria
- 2) MS2 virions

### Publication:

This research was peer reviewed and published in the journal of Environmental Science and Technology, January 2007, pages 606-612.

### Note:

This testing was conducted in a controlled environment. Field results may vary based on environmental conditions. The results have not been evaluated by the FDA. This product is not a medical device intended to diagnose, treat, prevent, or cure any disease.

# Control of Aerosol Contaminants in Indoor Air: Combining the Particle Concentration Reduction with Microbial Inactivation

SERGEY A. GRINSHPUN,<sup>\*</sup>  
 ATIN ADHIKARI, TAKESHI HONDA,<sup>†</sup>  
 KI YOON KIM,<sup>‡</sup> MIKA TOIVOLA,<sup>§</sup>  
 K. S. RAMCHANDER RAO,<sup>‡</sup> AND  
 TIINA HEPPONEN

Center for Health-Related Aerosol Studies, Department of Environmental Health, University of Cincinnati, 2223 Hillier Avenue, PO Box 479668, Cincinnati, Ohio 45267-0668

An indoor air purification technique, which combines unipolar ion emission and photocatalytic oxidation (promoted by a specially designed ActivePure-RCI cell), was investigated in two test chambers, 2.75 m<sup>3</sup> and 24.3 m<sup>3</sup>, using nonbiological and biological challenge aerosols. The reduction in particle concentration was measured sizes electively in real-time, and the Air Cleaning Factor and the Clean Air Delivery Rate (CADR) were determined. While testing with virions and bacteria, bioaerosol samples were collected and analyzed, and the microorganism survival rate was determined as a function of exposure time. We observed that the aerosol concentration decreased ~10 to ~100 times more rapidly when the purifier operated as compared to the natural decay. The data suggest that the tested portable unit operating in ~25 m<sup>3</sup> non-ventilated room is capable to provide CADR-values more than twice as great than the conventional closed-loop HVAC system with a rating 8 filter. The particle removal occurred due to unipolar ion emission, while the inactivation of viable air borne microorganisms was associated with photocatalytic oxidation. Approximately 90% of initially viable MS2 viruses were inactivated resulting from 10 to 60 min exposure to the photocatalytic oxidation. Approximately 75% of viable *B. subtilis* spores were inactivated in 10 min, and about 90% or greater after 30 min. The biological and chemical mechanisms that led to the inactivation of stress-resistant air borne viruses and bacterial spores were reviewed.

## Introduction

Exposure to respirable airborne particles and microbial agents may cause various health problems. Numerous techniques have been developed to reduce the exposure to indoor particles. Aerosol control in confined, poorly ventilated spaces, when the air exchange with filtration cannot be successfully applied, represents a particular challenge.

<sup>\*</sup> Corresponding author; phone: 1-513-696-0909; fax: 1-513-696-2269; e-mail: sergey.grinshpun@uc.edu.

<sup>†</sup> On leave from Kyoto Univ., Tokyo, Japan.

<sup>‡</sup> On leave from Ajou University, Suwon, South Korea.

<sup>§</sup> On leave from National Public Health Institute, Kuopio, Finland.

<sup>‡</sup> On leave from Karatik Engineering College, Hyderabad, India.

Another challenge is to decrease the indoor concentration of specific airborne contaminants, e.g., viable biological particles. While some indoor air purification techniques aim solely at the aerosol concentration reduction, others are designed to inactivate viable bioaerosols (e.g., viruses, bacteria, and fungi).

Some commercial air cleaners generate ozone (either as a primary biocidal agent or as a by-product); these devices have raised public health concerns (1). Among various guidelines for ozone exposure, the following thresholds have been specified for occupational environments: 0.3 ppm for 3 h (2), 0.06–0.10 for 8 h (2), 0.1 ppm for 8 h (3), and 0.05 ppm for instantaneous (no time limit specified) exposure (4). For comparison, the outdoor air standard is 0.08 ppm for 8 h (5). Ozone generators can inactivate viable microorganisms; however, the inactivation occurs at concentrations significantly exceeding health standards (6, 7).

Photocatalysis involving UV radiation and TiO<sub>2</sub> as a photocatalyst has been applied for gas-phase detoxification of organic contaminants (8, 9) and for inactivating microorganisms in water (10–12). Some effort has been made to explore its application for air cleaning inside a closed-loop system (13, 14). The investigators reported significant photocatalytic inactivation of stress-resistant *Serratia marcescens* that occurred when aerosolized bacteria circulated in a closed-loop duct equipped with a TiO<sub>2</sub> filter for a relatively long period of time. Pal et al. (15) found similar effect for *Escherichia coli*, *Micobacterium* sp., and *Acetobacter aceti*. Keller et al. (16) reported considerable inactivation of airborne *E. coli* passing through a photocatalytic control with TiO<sub>2</sub> film. The biocidal effect of the photocatalytic oxidation can be attributed to photo-generated valence-band holes, hydroxyl radicals, hydrogen peroxide, and other reactive oxygen species. Liu and Li (17) tested the viability change in airborne bacteria and fungi exposed to photocatalysis inside a small photocatalytic reactor for a very short time, on the order of a second. No significant decrease in the colony forming unit (CFU) count was observed during such a short time.

To our knowledge, no data are available on the effectiveness of portable UV/TiO<sub>2</sub>-based air purifiers to inactivate viable airborne microorganisms in indoor air environments. These data are needed to assess the feasibility of photocatalytic oxidation for air purification in residential and occupational settings. Furthermore, for hybrid air purifiers, which involve several air cleaning mechanisms, no sufficient information is available to differentiate their particle removal efficiency and the biocidal capabilities, which both aim at reducing the bioaerosol exposure in indoor air.

In this study, we investigated a novel air purification technique that combines different aerosol/bioaerosol control mechanisms: unipolar ion emission and photocatalytic oxidation promoted by the “radiant catalytic ionization” ActivePure-RCI” technique. Unipolar ion emission has been shown earlier to reduce the particle concentration in indoor air (18–20), but no scientific data are available on the efficiency of the hybrid-type technique.

## Experimental Section

The indoor air purification process was investigated in the experimental facility shown in Figure 1. The particle removal was determined by measuring the concentration of challenge aerosols also selectively in real-time. When testing with viable bioaerosols, the microorganism survival rate was also determined. The experimental protocols validated in our previous studies (21, 22, 23) were adopted. The experiments were conducted when a freestanding hybrid air purifier was

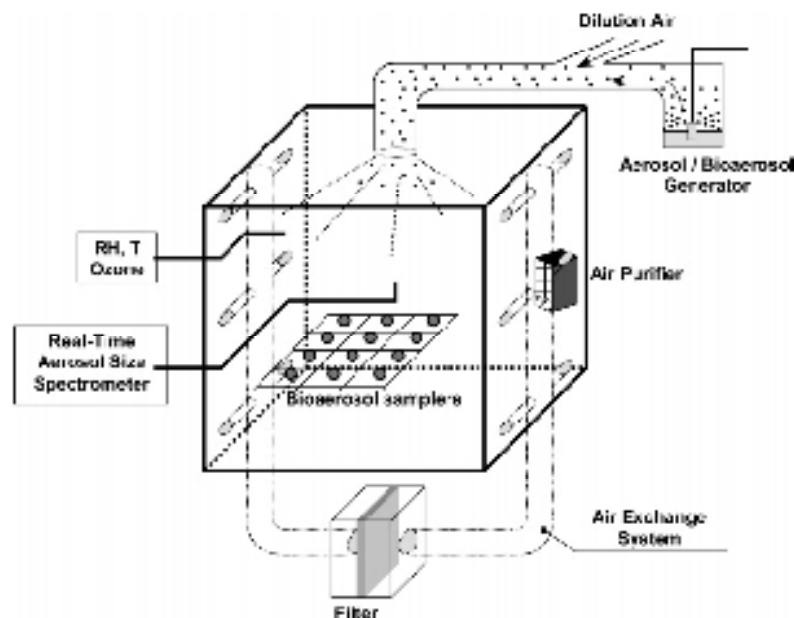


FIGURE 1. Experimental setup.

operating inside the chamber and when it was turned off. The challenge aerosol was generated from a liquid suspension using a Colson nebulizer (BGH Inc., Waltham, MA) and charge-equilibrated by passing through a 10- $\mu\text{m}$  CE<sub>2</sub> charge equilibrator (SM Company, St. Paul, MN). After being mixed with clean, HEPA-filtered air at a specific temperature ( $T = 24\text{--}26^\circ\text{C}$ ) and relative humidity (RH = 31–30%), the aerosol entered the chamber. Following a 10–15-minute adjustment period established to achieve a uniform aerosol concentration pattern, the experiment began ( $t = 0$ ).

In most of the tests, the aerosol concentration,  $C_i$ , and particle size distribution,  $\Delta C_i/\Delta \log(d_i)$ , were measured with an electrical low-pressure impactor (ELPI, TSI Inc./Dekati Ltd., St. Paul, MN), which utilizes the cascade impaction principle and also has a direct reading capability to determine the concentration of particles of different aerodynamic sizes in 12 channels (each channel = impaction stage), from 0.841 to 8.4  $\mu\text{m}$  (midpoint). When the experiments were conducted with viral aerosol that included particles smaller than the lower limit of the ELPI, we used a wide-range particle spectrometer (WPS; MSP Inc., Shoreview, MN). The WPS is a high-resolution real-time instrument combining differential mobility analysis, condensation particle counting, and laser light scattering to measure the diameter and number concentration of aerosol particles ranging from 18 nm to 10  $\mu\text{m}$ .

For every measured particle size,  $d_i$ , the aerosol concentration at  $t = 0$  was set to exceed the background level (obtained before the challenge aerosol was generated) by about 100-fold. First, the natural concentration decay was characterized by recording  $C_{\text{natural}}(d_i, t)$  every 10 s with the ELPI and every 2.5 min with the WPS. Subsequently, the test aerosol was generated and mixed in the chamber again to reach the same initial concentration level. At  $t = 0$ , the air purifier was turned on and the concentration  $C_{\text{exp}}(d_i, t)$  was measured during and up to 120 min (or until the particle count decreased below the limit of detection). To quantify the efficiency of the particle removal exclusively due to the air purifier operation, the Air Cleaning Factor (ACF) was determined size-selectively as a function of time:

$$\text{ACF}(d_i, t) = \frac{C_{\text{natural}}(d_i, t)}{C_{\text{exp}}(d_i, t)} \quad (1)$$

In addition, the overall particle removal rate was calculated as

$$\lambda(d_i, t) = \frac{1}{t} \ln \left[ \frac{C(d_i, t=0)}{C(d_i, t)} \right] \quad (2)$$

and the particle removal rate (exclusively due to air purifier) was defined following the first-order kinetics as

$$\text{FRR}(d_i, t) = \frac{1}{t} \ln \left[ \frac{C_{\text{exp}}(d_i, t=0)}{C_{\text{exp}}(d_i, t)} \right] - \frac{1}{t} \ln \left[ \frac{C_{\text{natural}}(d_i, t=0)}{C_{\text{natural}}(d_i, t)} \right] \quad (3)$$

In case  $C_{\text{exp}}(d_i, t=0) = C_{\text{natural}}(d_i, t=0)$ ,

$$\text{FRR}(d_i, t) = \frac{1}{t} \ln[\text{ACF}(d_i, t)] \quad (4)$$

This was needed to determine the Clean Air Delivery Rate (CADR), which, according to the ANSI/ASHRAE (American National Standards Institute/Association of Home Appliance Manufacturers) standard, is defined as

$$\text{CADR}(d_i, t) = V \times \text{FRR}(d_i, t) \text{ (m}^3/\text{h)} \quad (5)$$

The CADR concept allows for comparison of air cleaning efficiencies of a freestanding air purifier and a closed-loop ventilation/air-filtration system in an air volume  $V$  (note that FRR is a function of  $V$ ).

Two microbiological challenge aerosols, NaCl and smoke, were used to study the particle removal by the air purifier. The generated particles were primarily in the size range of 0.82–2.0  $\mu\text{m}$ , which includes ultrafine and fine fractions and represents most of the known viruses and bacteria. MS2 virus and *Bacillus subtilis* bacterial spores were the main biological challenge aerosols. Selected experiments were performed with *Pseudomonas fluorescens* bacteria.

MS2 bacteriophage, a 27 nm tailless non-enveloped icosahedral RNA-capsid, relatively stable against environmental stress, has been used in the past as a simulant of most mammalian viruses, and it is known as an indicator for enteric viruses (22–26). Stock suspension of MS2 virus was prepared by adding 8 ml of Lysde-Bertoni broth to freeze-dried phage vial (ATCC 15697-B1). This suspension was

filtered using a membrane filter of 0.3- $\mu$ m porosity and asexially diluted so that the neutrally suspended had  $10^4$ – $10^6$  PFU/mL [PFU = plaque forming unit]. MS2 phage filter was determined by following a modified plaque assay protocol of Adams (27); *Escherichia coli* (ATCC 15402, strain C3804) was used as the host organism.

*E. coli* is a gram-positive spore-forming bacterium with rod-shaped spores of approximately 0.7–0.8- $\mu$ m in width and 1.5–1.8- $\mu$ m in length (28). *E. coli* spores have previously been used in laboratory studies as a surrogate of environmentally resistant, pathogenic bacteria (29–31). Freeze-dried bacterial spores of *E. coli* (obtained from the U.S. Army Edgewood Laboratories, Aberdeen Proving Ground, Maryland) were activated at 55–60 °C for 26 min and then washed two times with sterile deionized water by vortexing followed by centrifugation at 2800 rpm for 7 min at room temperature. The total bacterial concentration in suspension was adjusted to  $10^7$ – $10^8$  per mL using a hemacytometer. The viable bacteria were enumerated by plating on trypticase soy agar (TSA) media at 30 °C for 18 h; the viable (culturable) concentration in the neutrally suspended was of the same order of magnitude as the total concentration, i.e.,  $10^7$ – $10^8$  CFU/mL [CFU = colony-forming unit]. *P. fluorescens* bacteria (used in selected tests) are relatively sensitive to environmental stresses. Prior to aerosolization, vegetative cells of *P. fluorescens* (ATCC 13636) were cultured in trypticase soy broth at 28 °C for 18 h and washed similarly as *E. coli* spores.

When testing with biological particles, air samples were collected using Biotek Samplers (BEC Inc., Eighty Four, PA) equipped with gelatin filters (BEC Inc.) and operated at a flow rate of 4 L/min for 5 min. Eight Biotek Samplers were utilized in each test generating one blank, one background sample, three samples taken at  $t = 0$ , and the other three taken at a specific time interval; four time intervals were tested:  $t = 10, 15, 30,$  and  $60$  min. Additional selected experiments were performed by using a BioSampler (BEC Inc., Eighty Four, PA) to collect *P. fluorescens* and *E. coli*. The BioSampler efficiently collects viable bacteria (28) while the liquid medium minimizes the desiccation stress. As its cutoff size is too high to efficiently sample small MS2 viruses, the BioSampler was not used as an alternative to gelatin filters for collecting MS2 virus.

The samples were analyzed for viable viruses (PFU) and bacteria (CFU) to quantify the percentages of those survived over time  $t$ . These were obtained with and without operating the air purifier. Our preliminary tests showed that the air purifier's operation considerably reduces the total bioaerosol concentration in the chamber due to ion emission. Therefore, the ion emitter was temporarily disabled in the lysol unit when testing virus and bacteria inactivation to ensure sufficient number of microorganisms for determining the viable count at the end of the test.

An aliquot of 200  $\mu$ L of dissolved gelatin filter extract was used for plaque assay to determine the number of viruses active (viable) viruses (PFU/cm<sup>2</sup>). Similarly, extract was cultured on TSA plates to obtain the bacteria concentration of viable bacteria (CFU/cm<sup>2</sup>).

Additional testing was initiated to examine whether the bacterial effect of the air purifier took place indeed in the aerosol phase (and not after microorganisms were collected on filters). For this purpose, aerosolized microorganisms were collected on eight gelatin filters during 5 min in the chamber without air purifier. Four filters were analyzed for viable microorganisms immediately after this test, while the other four were exposed to the air purifier in the chamber for 10, 15, 30, and 60 min and then analyzed. The comparison of two sets allowed examining if the microorganism inactivation occurred on filters during the collection process.


The ozone level and the air ion concentration were monitored in real-time in the chamber using an ozone monitor (PCI Ozone & Control Systems, Inc., West Caldwell, NJ) and an air ion counter (AlphaLab Inc., Salt Lake City, UT), respectively. The air temperature in the test chamber was  $24 \pm 2^\circ\text{C}$  and the relative humidity ranged from  $22 \pm 3\%$  to  $28 \pm 2\%$  as monitored with a thermo/hygrometer pen (Fisher Scientific Co., Pittsburgh, PA).

The purifier prototype (Ecoquest International Inc., Greeneville, TN) used in the study utilized an ion emitter and a specially designed ActivePure cell. The former produces negative ions in to indoor air, where they are acquired by aerosol particles. It is important to note that this method is different from air cleaning by charging particles at the entrance of the purifier and subsequently collecting them on metal electrodes by electrostatic precipitation. The ActivePure cell features a flow optimized target structure comprising matrices of elongated tubular elements made of polycarbonate and arranged in a parallel orientation on opposite sides or alternatively on four sides of a broad-spectrum UV light source. The UV lamp utilizes argon gas with mercury and carbide filaments with a spectral output between 100 and 367 nm. Besides, a coating was applied to the target structure of the cell comprising hydrophilic properties and containing the following grouping of materials: titanium dioxide, rhodium, silver, and copper. As a result, a photo-catalytic oxidation forms reactive species, such as hydroxyl radicals, valence-band holes, superoxide ions, and hydrogen peroxides.

The tests were conducted in two indoor test chambers, including a large walk-in chamber (24.3 m<sup>3</sup>) that simulated a residential room and a smaller chamber (2.76 m<sup>3</sup>) that simulated a confined space (e.g., bathroom, small office area, or automobile cabin). The particle removal was investigated in both chambers, whereas the bioaerosol viability tests were performed in the smaller chamber that was made of stainless steel and allowed bio-decontamination. The air purifier was tested in non-ventilated chambers (no air exchange) as it is known that portable air cleaners are primarily beneficial in poorly ventilated spaces (20, 21). Air-exchange was introduced only when testing the closed-loop ventilation/air-filtration system equipped with an HVAC filter to compare its performance to that of the portable air purifier in terms of CACR. The ventilation/air-filtration system was also deployed to clean the test chamber between experiments. In most of the tests, the air purifier operated in the corner of the chamber, facing the center. A separate experiment was carried out to examine whether its location and orientation affected the ACE.

## Results and Discussion

**Particle Removal from Air.** Figure 2 shows the evolution of the concentration and particle size distribution of NaCl aerosol when the air purifier operated in the large test chamber. As seen from this example, the aerosol concentration of 0.1- $\mu$ m particles decreased by a factor of 28 in 1 h and by a factor of about 250 in 2 h; the corresponding decreases for 1- $\mu$ m particles were approximately 10- and 50-fold. When testing with smoke particles, the aerosol concentration decreased even more rapidly. The above levels of the aerosol concentration reduction are considerably greater than those predicted by either unimpacted or stirred natural decay models (32). This result was obtained when both the air ion emitter and the ICI cell operated in the unit. Interestingly, statistically the same particle reduction effect ( $p > 0.05$ ) was observed when the ICI cell was turned off and only the ion emitter operated. This latter finding provides the evidence that the particle removal was achieved as a result of unipolar ion emission but not due to photocatalytic reactions.

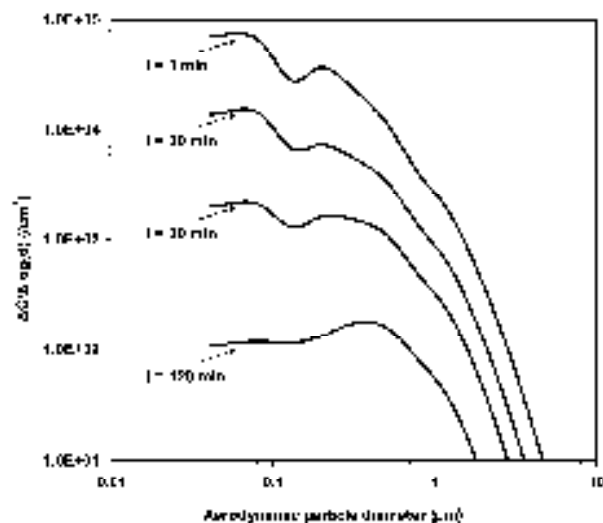


**FIGURE 3.** Particle concentration and size distribution of NaCl aerosol as measured with the GLP in the 24.3 m<sup>2</sup> chamber with the air purifier operated facing the chamber's center at 1.7 m from the measurement point. No ventilation in the chamber. The initial total aerosol concentration =  $1.88 \times 10^{16}$  /cm<sup>3</sup>.

This finding agrees with previously published data on the effect of unipolar air ionization on the airborne concentration [18–21]. The air purification is particularly efficient at higher initial aerosol concentrations ( $> 10^8$  particles/cm<sup>3</sup>) that ensure adequate interaction between the air ions and aerosol particles. As mentioned above, the effect is expected to be much more pronounced in non-ventilated environments than in ventilated ones.


The aerosol reduction was especially high for the particles of  $d \leq 0.5 \mu\text{m}$ . E.g., when the air purifier with an ion output of  $\sim 10^{16}$  ions/sec continuously operated in a corner of the 24.3-m<sup>2</sup> chamber facing the center for 2 h, ACP reached  $\sim 60$ –70 for  $d = 0.08$ – $0.9 \mu\text{m}$  and  $\sim 13$ –16 for  $d = 0.8$ – $2 \mu\text{m}$  (in the tests conducted with NaCl and smoke as challenge aerosols). The same ACP levels may be achieved more rapidly in indoor environments of smaller volumes and slower in larger spaces. The experimental trends agree with the ion-induced aerosol removal model [26].

The ACP was found to depend not only on the operation time and the particle size but also on the location/orientation of the purifier in the chamber. For example, a corner location facing the center of the room was found preferable as opposite to the orientation facing the wall. The difference in ACP obtained for the center and corner locations was significant and increased with the operation time. The shaded area in Figure 3 presents the ion-induced Air Cleaning Factor when the particle size-selective data were integrated over the measured sizes of NaCl particle up to  $2.5 \mu\text{m}$  and averaged over the three selected locations/orientations in the 24.3-m<sup>2</sup> chamber: in the corner facing the center, in the center, and at 80 cm from the wall facing it.

Figure 4 presents the CADR values achieved by operating the tested air purifier for five selected sizes of NaCl and smoke particles acting as aerosol contaminants in the non-ventilated 24.3 m<sup>2</sup> chamber. The CADR ranges approximately from  $43.1 \pm 0.1$  to  $82.1 \pm 1.8$  m<sup>3</sup>/h for NaCl particles of  $d = 0.04$ – $1.88 \mu\text{m}$ , and from  $72.4 \pm 0.9$  to  $115.5 \pm 10.8$  m<sup>3</sup>/h for smoke particles of the same size range. The difference may be attributed to different ability of NaCl and smoke particles to acquire electric charges from air ions, which results in their different mobilities and subsequently different migration velocities. The above explanation seems valid given that unipolar ion emission was shown to be the major mechanism causing the aerosol particle concentration reduction.

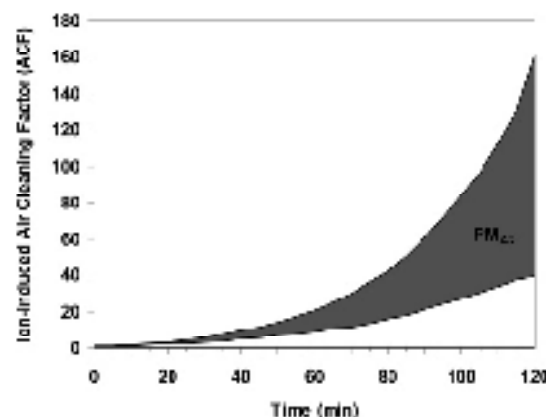

**FIGURE 2.** The ion-induced Air Cleaning Factor (ACF) for PM<sub>2.5</sub>, NaCl as measured with the GLP and integrated for deionization and orientation of the air purifier in the 24.3 m<sup>2</sup> chamber. No ventilation in the chamber. The initial PM<sub>2.5</sub> aerosol concentration =  $(3.088$ – $1.88) \times 10^8$  /cm<sup>3</sup>.

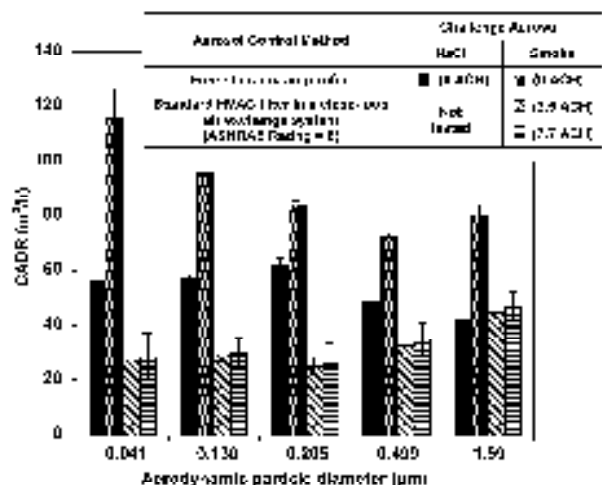

**FIGURE 4.** Clean Air Delivery Rate (CADR) determined for the NaCl and smoke aerosols as measured with the GLP in the non-ventilated 24.3 m<sup>2</sup> chamber. The performance of the air purifier is compared to that of a standard HVAC filter (ASHRAE rating = 8) installed in the closed-loop air exchange system of the chamber.

In addition, Figure 4 presents the CADR values achieved by the closed-loop air exchange system equipped with a standard ASHRAE rating 8 HVAC filter at two air exchange rates, 2.5 and 2.7 ACH. The data suggest that the tested portable air purifier operating in about 26 m<sup>3</sup> non-ventilated room is capable to provide a CADR more than twice greater than the conventional central HVAC system with the rating 8 filter. Obviously, more efficient particulate filters provide more rapid reduction of aerosol contaminants and may perform better than the tested air purifier. For example, compared to the portable unit, HEPA filter installed in the closed-loop air exchange system of the 24.3 m<sup>2</sup> chamber provided approximately 4- and 3-fold greater CADRs at 2.5 and 2.7 ACH, respectively, when challenged with NaCl particles, and 2.2- and 1.4-fold greater when challenged with smoke particles. However, HEPA filters are rarely used in residential central HVAC systems because of the high-pressure drop and the loading effect on their performance.

The particle removal from indoor air by the hybrid air purification technique was also investigated in the smaller (2.76 m<sup>2</sup>) chamber, which otherwise was utilized primarily for assessing the viable microorganism inactivation. The CADR values obtained with MSS viruses from the WPS measurements were  $79 \pm 5$  m<sup>3</sup>/h, which is in the CADR-

**TABLE 1.** Percentage of *Moraxella* *Morax* spores Survival over Time *t* in the 2.78 m<sup>3</sup> Chamber with the HEI-cell Operating in it, as Measured via PFU Count (for MS2 Virus) or CFU Count (for *Staphylococcus aureus* Enterococcus)<sup>a</sup>

exposure time, <i>t</i> (min)	percentage (mean ± SD) of viable microorganisms measured in the chamber with air purifier operating during time <i>t</i>	
	MS2 virus, PFU/(m <sup>3</sup> × 10 <sup>6</sup> ) <sub>t=0</sub> → PFU/(m <sup>3</sup> × 10 <sup>6</sup> ) <sub>t=t</sub>	<i>Staphylococcus aureus</i> Enterococcus, CFU/(m <sup>3</sup> × 10 <sup>6</sup> ) <sub>t=0</sub> → CFU/(m <sup>3</sup> × 10 <sup>6</sup> ) <sub>t=t</sub>
10	9.2 ± 2.0 (n = 6)	24.1 ± 2.7 (n = 2)
75	9.2 ± 4.2 (n = 12)	15.7 ± 1.7 (n = 2)
20	9.2 ± 1.1 (n = 9)	7.8 ± 1.1 (n = 2)
80	10.2 ± 1.7 (n = 6)	10.1 ± 1.2 (n = 2)

<sup>a</sup> Measured sampling was conducted with the Bacter Sampler equipped with gelatin filters. *n* = number of replicates.

range obtained for NaCl and smoke particles in the large chamber for the viral size. This suggests the feasibility of using microbiological particles to determine the ion-induced aerosol reduction of bio-particles of the same size range. Furthermore, this finding implies that, at least for the particle size range representing MS2 viruses, PFI due to ion emission in indoor air environment is inversely proportional to the air volume (see eq 6).

DOSES. In both test chambers (non-ventilated), the ozone concentration gradually increased as the purifier was continuously operating. In the 24.3-m<sup>3</sup> chamber, it increased from 0.008 to 0.06 ppm in about 36 min, while in a smaller (2.78-m<sup>3</sup>) chamber the ozone increase occurred in approximately 5 min. However, once an air exchange was introduced (as low as 1 ACH), the ozone concentration in the 24.3-m<sup>3</sup> chamber did not significantly increase as compared to the initial level (*p* > 0.05). Our monitoring data obtained with the tested unit operating in a non-ventilated room of ~100 m<sup>3</sup> (not presented here) suggest that the ozone level can be kept below 0.06 ppm while the unit continuously operates for many hours.

Some air purifiers utilizing ion emission and, to a greater extent, the photocatalytic oxidation may cause greater increase of indoor ozone concentration than the tested one. The use of such devices in confined occupied air spaces may not be appropriate as their continuous operation may eventually lead to excessive ozone levels and, in the presence of certain chemical compounds, produce nanoparticles (20). Although the unipolar ion emission has a potential to suppress this effect, it seems important to keep the ozone level below existing thresholds. We believe that the solution can be found by implementing an intermittent regime (as an alternative to continuous one), which allows the air purifier operating until the ozone reaches a certain level, after which the ozone-generating element is automatically turned off to allow the ozone concentration to drop; then the cycle can be repeated.

**Microbial Inactivation.** Table 1 summarizes the microbial inactivation results. Only approximately 10% of initially viable MS2 viruses survived 10–80 min exposure to the purifier in the chamber and about 80% were inactivated. When the natural concentration decay of aerosolized MS2 was monitored in the chamber (with no purifier operating), we found that the concentration of active viruses was relatively stable; the decrease did not exceed 30.3 ± 0.8% during 1 h. The data suggest that the viral inactivation occurs rather quickly since the percent of survived viruses did not show dependence on the exposure time for *t* = 10–80 min. Thus, a relatively short time may be sufficient to reduce the percent of viable viruses in an air volume by a factor of 10 while those that survived showed remarkable resistance to the oxidizing stress. When aerosolized viruses are exposed to photocatalytic oxidation, the hydroxyl radicals can affect the protein capsid and binding sites, thus disabling the virus's subsequent interaction with

the host and formation of PFUs (26). Additionally, the TiO<sub>2</sub> photocatalytic cell may produce oxidative damage to the virus capsid (26) and the radicals may cause alteration in the virus's genetic material (26, 27). Our findings suggest that the hybrid air purifier may be used continuously for short time intervals or in intermittent regime to achieve considerable virus inactivation rate. On the other hand, a prolonged operation of the air purifier is believed to be advantageous in environments with a continuous supply of "fresh" active viruses.

Approximately 75% of *Staphylococcus aureus* spores exposed to the air purifier were inactivated during the first 10 min, 86% during the first 15 min, and about 90% or greater after 30 min (Table 1). Between 50 and 80 min of exposure, we did not observe significant decrease in the number of survived spores (similar to the trend found for viruses), which suggests a constancy of the effect. The natural decay in the culturable count was not significant (*p* > 0.05) during 1 h, as measured using the Bacter Sampler equipped with gelatin filters. However, the overall standard deviation of the data obtained in these control tests was as high as 68% and the CFU counts from filters were close to the detection limit. To address this issue, we measured the natural decay of viable *S. aureus* spores with the BioSampler at *t* = 0 and at *t* = 2 h. It was confirmed that the viability was constant within about ±20% in the absence of the air purifier.

In bacteria, the inactivation process by reactive hydroxyl radicals can proceed in five reaction pathways:

- oxidation of coenzyme A causing inhibition of cell respiration and cell death (28);
- destruction of the outer membrane of bacterial cells (12);
- oxidation of unesterified phospholipid in bacterial cell membrane (29);
- leakage of intracellular K<sup>+</sup> ions (12); and
- deleterious effects on DNA and RNA (26, 27).

One reason that the inactivation of *S. aureus* endospores was time-dependent is their thick membrane layer containing peptidoglycans. This is consistent with the study of Matsumoto et al. (40), who found that photooxidation of coenzyme A by the TiO<sub>2</sub> photocatalyst was not entirely effective against the algae *Chlorella vulgaris* in water because of its thicker cell wall. Some other self-defense mechanisms of bacteria against the oxidative stress, including synthesis of superoxide dismutase enzymes, can also slow down the inactivation process (41).

Although the time was a factor in the bacterial spore inactivation, the viability loss occurred relatively quickly for both the MS2 virus and *S. aureus*. This can be attributed to rapid interaction of valence-band holes (h<sup>+</sup>) (TiO<sub>2</sub> + hv → h<sup>+</sup> + e<sup>-</sup>) with the organic substances, which are present in the viral and bacterial outer walls or membranes. The above-mentioned interaction likely occurs before considerable number of hydroxyl radicals (OH) is generated in the air volume. Although previous studies (12, 22) emphasized the role of hydroxyl radicals [TiO<sub>2</sub> + h<sup>+</sup> → OH + H<sup>+</sup>], these radicals may not be the primary factor in microbial inactivation, particularly in the air. Furthermore, since our experiments were conducted in relatively dry air (RH < 30%), water molecules were not predominant species in contact with the catalyst, and thus the contribution of hydroxyl radicals was likely much lower than in liquids. Sheng et al. (2) have concluded that in the gas phase, organic compounds, such as krypton, can readily interact with photo-generated holes while the interaction with water vapor molecules is not as predominant. Alberici and Jordan (8) have reported that the valence-band holes generated from TiO<sub>2</sub> photocatalysis are capable of oxidizing any organic compound. The process also produces hydrogen peroxide [Cl<sub>2</sub> + e<sup>-</sup> → Cl<sub>2</sub><sup>-</sup>; Cl<sub>2</sub><sup>-</sup> + H<sup>+</sup> → HCl<sub>2</sub>; 2HCl<sub>2</sub><sup>-</sup> → Cl<sub>2</sub> + H<sub>2</sub>O<sub>2</sub>], which can freely penetrate into cell membranes and walls and cause microbial inactivation

[43]. Further microbiological studies on the role of gas-phase  $\text{TiO}_2$  catalysis on the airborne microorganisms as well as studies on the reaction kinetics at the aerosol phase seem worthwhile to further examine the above interpretations.

Experiments with *P. fluorescens* revealed CFU counts below the detection limit both in the test and control samples. In contrast to *A. baumannii* endospores, even a very short exposure to ambient air (RH < 30%) considerably decreased the viability of aerosolized *P. fluorescens* vegetative cells, which are known to be stress-sensitive. Perhaps, microorganisms sensitive to desiccation stress are more suitable for this kind of test if the test is performed at higher relative humidity levels.

Additional control experiments were performed to investigate if the viability decrease found for MS2 virus and *A. baumannii* spores occurred in the aerosol phase or on the sampling filter. For MS2, we found that  $1836 \pm 270$  PFU/mL and  $1845 \pm 325$  PFU/mL developed when filter extracts were cultured from unexposed and 10-min exposed galena filters, respectively. For *A. baumannii*, we observed  $1770 \pm 376$  CFU/mL and  $1126 \pm 410$  CFU/mL in extracts taken from unexposed and 48-min exposed filters, respectively. No significant changes in either viral or bacterial viability occurred as a result of a non-aerosol exposure ( $p > 0.05$ ). Thus, these findings confirm that the viral and bacterial inactivation observed in our tests indeed occurred in the aerosol phase and was not associated with the inactivation on filter.

**Controlled Effect (Sample Calculation).** It was concluded that the particle removal took place solely due to unipolar ion exclusion, while the inactivation of viable airborne MS2 viruses and *A. baumannii* spores occurred due to the photocatalytic reaction promoted by the RCI cell. Both mechanisms working simultaneously in a hybrid type air purifier may result in considerable decrease of the exposure to pre-existing viable aerosol microorganisms in indoor environment. Ozone produced by the RCI cell is not believed to cause significant microbial inactivation because its level was not sufficient. Tseng and Li (67) referred to 3.43 ppm as an appropriate level for airborne MS2 virus, and Li and Wang (44) did not observe any inactivation of airborne *A. baumannii* spores at  $\text{O}_3$  as high as 20 ppm.

The following estimate was made based on the experimental data obtained in this study. Assuming that the ion induced air cleaning removes about 80% of viable airborne pathogens from a room air in 30 min and the ActivePure (RCI)-induced photooxidation leaves only 10% of the remaining airborne micro organisms viable, the overall aerosol exposure to the viable pathogen in this room after 30 min is reduced by a factor of about 50.

The observed rapid inactivation of micro organisms makes unnecessary to run the ActivePure cell continuously. The data suggest that it can be used "part-time" for 10-30 min and "rest" for about 1-2 h until the background ozone level is reached (proposed above as an intermittent regime), while the ion emission can take place continuously to keep the aerosol concentration decreasing.

#### Acknowledgments

This investigation was partially supported by the EcoQuest International. The participation of Dr. K. Y. Kim was partially funded by the Korea Research Foundation Postdoctoral Fellowship Program. This support is greatly appreciated. We also thank Dr. Daphne Lee for the technical assistance. **Disclaimer:** Reference to any companies or specific commercial products does not constitute or imply their endorsement, recommendation or favoring by the authors or the University of Cincinnati.

#### Literature Cited

[1] EPA [U.S. Environmental Protection Agency]. *Control guidelines that are used as air cleaners: an assessment of effectiveness and*

health consequences. <http://www.epa.gov/oap/pubs/assess-generators.html> Accessed on May 23, 2005.

- [2] ACGIH [American Conference of Governmental Industrial Hygienists]. *Threshold Limit Values for Chemical Substances and Physical Agents & Biological Exposure Indices*. ACGIH, Cincinnati, OH, 2004, p. 44.
- [3] OSHA [Occupational Safety & Health Administration]. *Regulations* (29 CFR). *Part 1910.1000*. <http://www.osha-slc.gov/pls/otext.pl?getfile=section&file=/d1910-1000> Accessed on May 21, 2005.
- [4] FDA [U.S. Food and Drug Administration]. *Labeling Regulatory Requirements for Medical Devices*. HHS publication FDA 20-0004. U.S. Government Printing Office, Washington, DC, 1999.
- [5] EPA [U.S. Environmental Protection Agency]. *National Ambient Air Quality Standards (1997)*. <http://www.epa.gov/air/airquality.html> Accessed on May 24, 2005.
- [6] Fawcett, K. K.; VanDyke, D. W.; Stetler, R. S. Investigation of gas-phase ozone as a potential bioicide. *Appl. Environ. Microbiol.* 1997, 63, 895-898.
- [7] Li, C.-S.; Wang, Y.-C. Surface photocatalytic effects of ozone for microorganisms. *AMB J.* 2002, 64, 892-897.
- [8] Alkhalil, H. M.; Canak, M. C.; Ibrahim, M. N.; Jorjori, W. F. Catalyst characteristics for the gas phase destruction of nitrogen-containing organic compounds using  $\text{TiO}_2/\text{UV-VIS}$ . *Appl. Catal., B* 2000, 28, 1-8.
- [9] Sheng, J.; Du, Y.; Xu, Z. Photocatalytic oxidation of heptane in the gas-phase over  $\text{TiO}_2$ . *Chemosphere* 2002, 45, 89-94.
- [10] Matsuura, T.; Yamada, E.; Nishijima, T.; Nakamura, H.; Komari, T. Continuous sterilization system that uses photooxidation-decolor powder. *Appl. Environ. Microbiol.* 1999, 65, 1828-1832.
- [11] Saito, T.; Imai, T.; Ebata, J.; Morikawa, T. Mode of photocatalytic bactericidal action of powdered semiconductor  $\text{TiO}_2$  on Streptococcal mutants. *J. Photochem. Photobiol.* 1993, 14, 969-976.
- [12] Sasaki, K.; Kikuchi, Y.; Hoshikawa, K.; Fujishima, A. Bactericidal and detoxification effects of  $\text{TiO}_2$  thin film photocatalyst. *Environ. Sci. Technol.* 1997, 31, 226-230.
- [13] Gamsari, D. Y.; Tsvetov, D. M.; Elisei, S. S. Photocatalytic disinfection of indoor air. *Trans. ASHRAE* 1997, 113, 83-88.
- [14] Gamsari, D. Y.; Hingorani, S.; Givoni, B.; Gamsari, D. Y.; Elisei, S. S. Photocatalytic system to destroy microorganisms in air. *J. Adv. Infiltration Tech.* 1999, 4, 126-132.
- [15] Pal, A.; Mita, K.; Yu, L.; Pehkonen, S.; Qi, B.; M. B. Photocatalytic inactivation of microorganisms by  $\text{TiO}_2$  coated membranes. *Int. J. Chem. Reactor Eng.* 2005, 3, 401.
- [16] Keller, V.; Keller, H.; Lechner, M.; J. Lutz, M.-C. Biological agent inactivation in a flowing air stream by photocatalysis. *Chem. Commun.* 2005, 25, 2816-2818.
- [17] Liu, C.-Y.; Li, C.-S. Effectiveness of titanium dioxide photocatalytic filter for controlling microorganisms. *Environ. Sci. Technol.* 2002, 37, 182-190.
- [18] Gokulapriya, S. A.; Marudhi, G.; Trivedi, M.; Adhikari, A.; Rajaram, T.; Vaidyan, K. Evaluation of indoor pollution for reducing aerosol exposure in confined indoor spaces. *Indoor Air* 2005, 15, 236-241.
- [19] Lee, B. O.; Yoon, S. M.; Gokulapriya, S. A. Catalytic ion exclusion enhances respiratory protection against fine and ultrafine particles. *J. Aerosol Sci.* 2004, 35, 1200-1209.
- [20] Miyata, Y.; Sa, S.; Saito, E. K.; Kim, A.; Saito, P. Aerosol removal by unipolar ionization in indoor environments. *J. Aerosol Sci.* 2004, 35, 939-941.
- [21] Gokulapriya, S. A.; Adhikari, A.; Lee, B. O.; Trivedi, M.; Marudhi, G.; Yoon, S. M.; Rajaram, T. Indoor air pollution control through ionization. In *Air Pollution XII*; Ibrahim, C. A., Ed.; IIT Press: Southampton, U.K., 2004; pp 702-704.
- [22] Keller, M. H.; Sattar, S. A. A new ozone-based method for virus inactivation: proof-of-concept study. *Phys. Med. Biol.* 1997, 42, 2027-2038.
- [23] O'Connor, K. P.; Busher, J. H.; Anderson, P. B.; Cox, C. J.; Khan, A. S.; Gamsari, D. Y.; Vaidyan, J. J. Real-time fluorescence-activated transcription-PCR assays for detection of bacteriophage MS2. *Appl. Environ. Microbiol.* 2004, 70, 478-483.
- [24] Jones, M. V.; Bullock, K.; Alkhalil, H.; Ibrahim, H. The use of bacteriophage MS2 as a model system to evaluate virus-like model disinfectants. *J. Hosp. Infect.* 1991, 17, 278-286.
- [25] Havelaar, A. H.; van Duynhoven, M.; Drost, Y. C. F. Specific RNA bacteriophages are adequate model organisms for enteroviruses in fresh water. *Appl. Environ. Microbiol.* 1998, 64, 2000-2002.
- [26] Alford, P. H.; Malik, Y. S.; Hurlbut, C. W.; Copel, S. M. Survival of F-specific RNA coliphage, feline calicivirus, and Herpesvirus saimiri in water: a comparative study. *Appl. Environ. Microbiol.* 2002, 68, 6767-6770.
- [27] Adams, M. H. *Bacteriophages*; International Publishers, Inc.: New York, 1980.

- [30] Johnson, R.; Martin, H. D.; Burch, J. G. Efficiency of selected respiratory protective equipment challenged with Bacillus anthracis spores. *Appl. Environ. Microbiol.* 2004, 70, 2168–2170.
- [31] Liu, X.; Repomus, T. A.; Wilhelm, K.; Gekhalov, S. A.; Pardo, K.; Bower, D. Long-term sorption of airborne bacteria and fungi into a nano-suspension liquid. *Atmos. Environ.* 1999, 33, 4281–4290.
- [32] Liu, X.; Repomus, T. A.; Wilhelm, K.; Wang, Z.; Gekhalov, S. A.; Tamm, M. Survival of airborne microorganisms during wetting aerosol collection. *Atmos. Sci. Technol.* 2000, 32, 184–192.
- [33] Mikulic, G.; Gekhalov, S.; Wilhelm, K.; Repomus, T.; Urvolac, V.; Hutz, P. Collection of airborne microorganisms by electrostatic precipitation. *Atmos. Sci. Technol.* 1999, 30, 127–144.
- [34] Hinds, W. C. *Aerosol Technology: Properties, Behavior, and Measurement of Airborne Particles*, 2nd ed.; John Wiley & Sons, Inc.: New York, 1998.
- [35] Gekhalov, S. A.; Tsvetkova, M.; Liu, X.; Repomus, T. Formation of Nanoparticles in Indoor Air at an Increased Source Level. In *Abstracts of the 20th Annual Meeting of the Aerosol Association for Aerosol Research*, Seattle, Texas, U.S.A., October 27–31, 2000; AAAA: Mt. Laurel, NJ, 2000; p 337.
- [36] Von Sonntag, C. Disinfection by free radicals and UV-catalysis. *Water Supply* 1999, 4, 11–18.
- [37] Yuzhi, C. S.; Otsu, D. P. Photochemical degradation of organic water contaminants: mechanisms involving hydroxyl radical attack. *J. Catal.* 1999, 122, 178–182.
- [38] Durford, R.; Sillman, A.; Cal, J.; Surpren, N.; Harkins, S.; Holsen, H.; Kowaluk, J. Chemical oxidation and DNA damage induced by inorganic aerosols. *Environ. Health Perspect.* 1997, 105, 67–70.
- [39] Holsen, H.; Harkins, S.; Surpren, N.; Kowaluk, J. In vitro photochemical damage to DNA, RNA, and their bases by an inorganic aerosol agent in comparison to UVB and UVC radiation. *J. Photochem. Photobiol. A* 1997, 111, 209–218.
- [40] Vukob, A.; Guevara, D. Y.; Deshayes, D. A.; Blank, S. S. Enhanced photochemical formation of bacterial spores on surfaces in air. *J. Ind. Microbiol. Biotechnol.* 2000, 32, 884–890.
- [41] Miron, P. C.; Szolnoki, S.; Hahn, D. M.; Huang, Z.; Williams, K. J.; Jacoby, W. A. Bactericidal activity of photo-catalytic TiO<sub>2</sub> coatings toward an understudied set of building microflora. *Appl. Environ. Microbiol.* 1999, 65, 4094–4097.
- [42] Miron, P. C.; Szolnoki, S.; Hahn, D. M.; Huang, Z.; Williams, K. J.; Jacoby, W. A. Bactericidal activity of photo-catalytic TiO<sub>2</sub> coatings toward an understudied set of building microflora. *Environ. Microbiol. Lett.* 1999, 22, 211–214.
- [43] Holsen, A. C.; Polgoc, C. Photo-catalytic inactivation of E. coli: effect of [ammonium-ions] light intensity and of [suspended-solid] TiO<sub>2</sub> concentration. *Appl. Catal., B* 2003, 44, 303–304.
- [44] Miron, P. C.; Shi, J.; Shi, S. Y. Molecular mechanism of resistance to heat and oxidative damage. *J. Appl. Microbiol. Symp. Suppl.* 1994, 74, 625–628.
- [45] Tseng, C.-C.; Li, C.-S. Causes for inactivation of aerosolized bacteriophages. *Atmos. Sci. Technol.* 2004, 40, 683–688.
- [46] Li, C.-S.; Wang, Y. C. Inactivation effects of airborne ozone for bacteriophage. *J. Environ. Health* 2000, submitted.

Received for review June 8, 2006; revised manuscript received September 13, 2006; accepted October 20, 2006.

ES061573H